


--- CONTROL JOINTS -  
3/4" DEEP x 1/4" WIDE

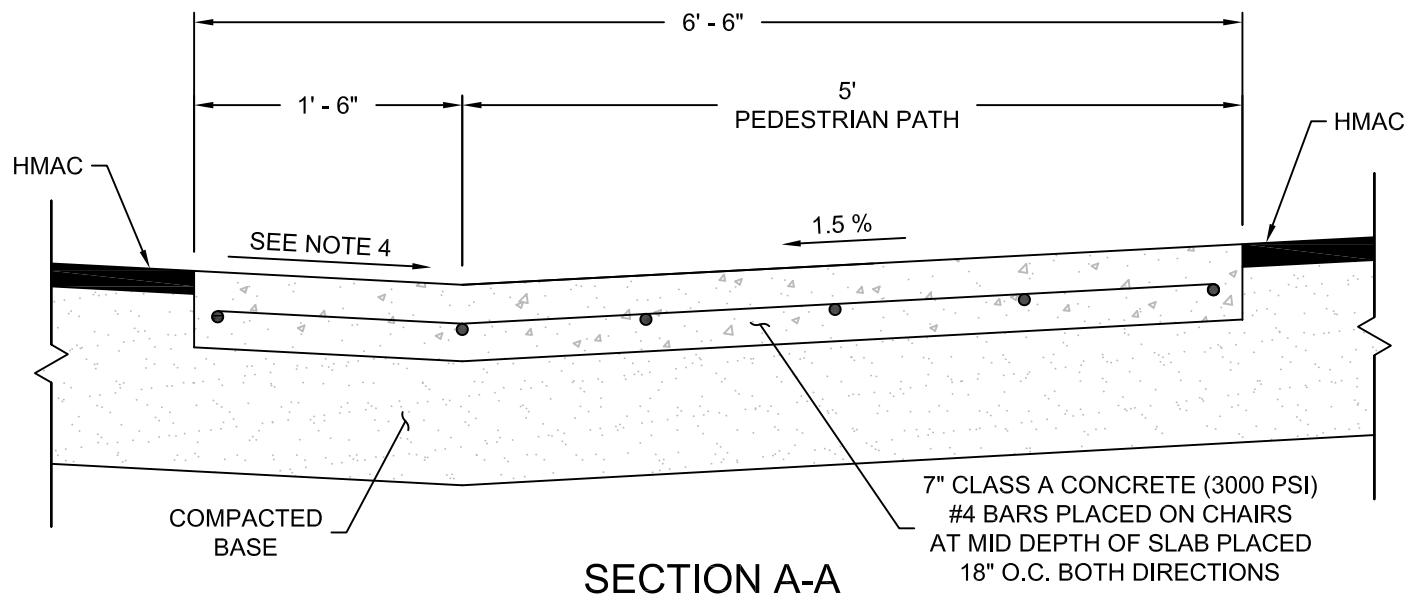

**NOTES:**

1. MONOLITHIC CURB AND GUTTER SHALL BE MEASURED BY PLAN QUANTITY PER SQUARE FEET AND PAID AS VALLEY GUTTER.
2. MINIMUM SLOPE FROM POINT "A" TO POINT "B" SHALL BE 0.50%.
3. ALL CONTROL JOINT WILL BE TOOL JOINT OR SAW CUT WITH WALK BEHIND SAW.
4. MATCH CROSS-SLOPE OF ROAD 2% TYPICAL ~ 1.5% MIN. OR 3% MAX.
5. INSTALL COLD JOINT IF NEEDED TO MAINTAIN TRAFFIC. SEE DETAIL 420S-3-SM.

REFERENCES  
DETAIL 430S-3-SM

The City of San Marcos Engineering and Capital Improvements	CURRENT AS OF 1/1/2021	CONCRETE VALLEY GUTTER	
RECORD COPY SIGNED BY LAURIE MOYER, P.E.	1/1/2021 ADOPTED	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	STANDARD NO. <b>436S-2-SM</b> 1 OF 1