


PLACEMENT

FEATURES	DISTANCE
FIRE HYDRANT	5'
ALL OTHERS	2'

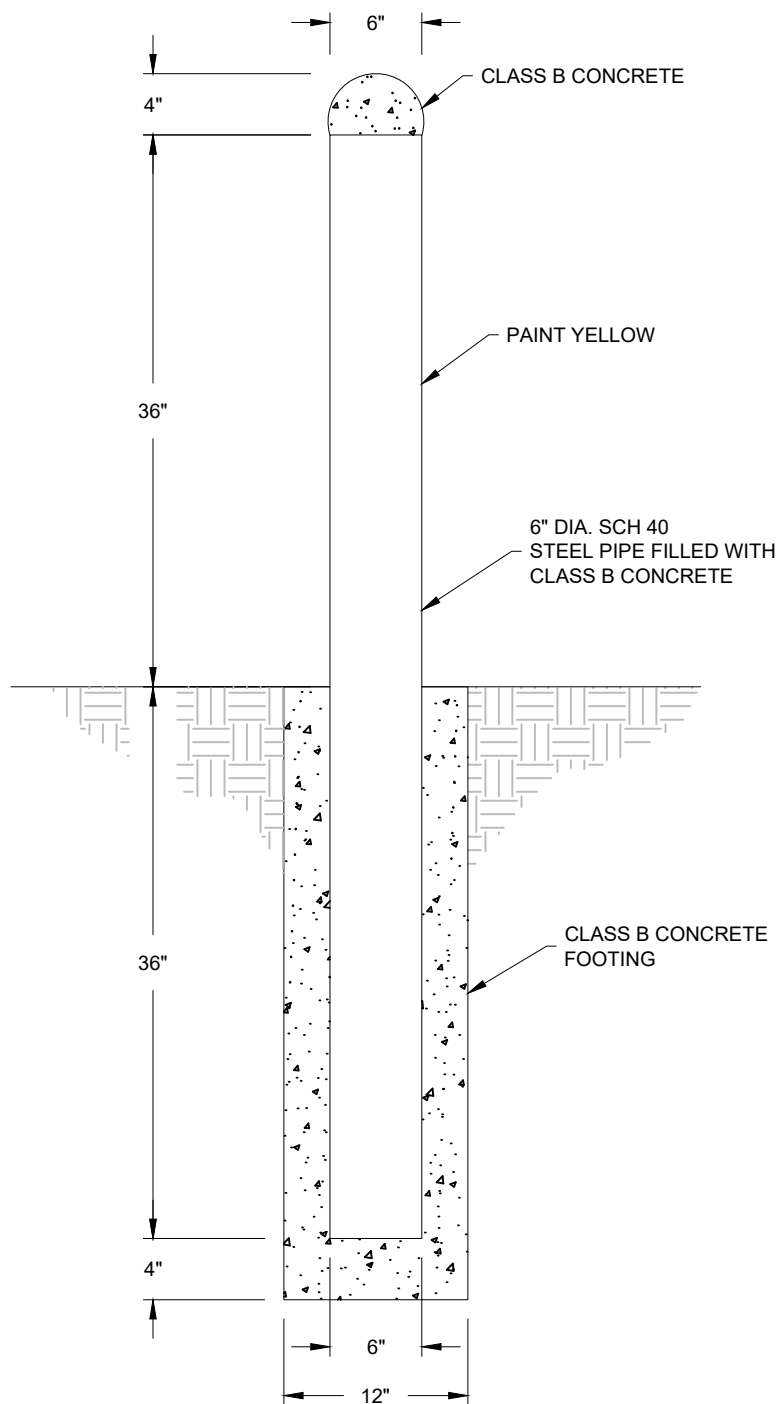

NOTES

1. TWO BOLLARDS SHALL BE INSTALLED AT A DIAGONAL ADJACENT TO ALL VALVES, PORTS AND ALL OTHER SURFACE FEATURES CALLED OUT IN PLANS OR REQUIRED BY INSPECTOR.
2. BOLLARD INSTALLATION SHALL BE SUBSIDIARY TO INSTALLATION OF SURFACE FEATURE.

The City of San Marcos Engineering and Capital Improvements		CURRENT AS OF 1/1/2021	TYPICAL CONCRETE FILLED STEEL PIPE BOLLARD	
RECORD COPY SIGNED BY LAURIE MOYER, P.E.		1/1/2020 ADOPTED	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	STANDARD NO. 500S-B-SM 1 OF 1