


PROFILE VIEW

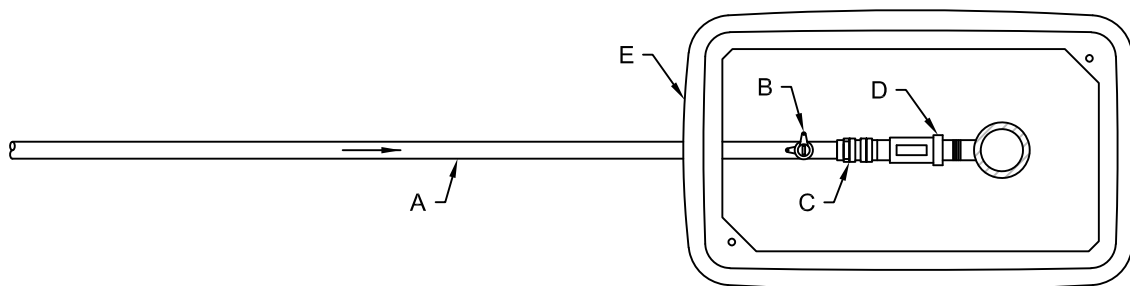

METER ASSEMBLY PLAN VIEW

SEE NOTE 7 FOR SPACING

MATERIALS		
LABEL	ITEM	SIZE
*A	TUBING PER STANDARD PRODUCT LIST - TYPE K COPPER WW-613 OR POLYETHYLENE WW-65	1"
B	APPROVED ANGLE METER STOP WITH PADLOCK WING. (COMPRESSION-TYPE FITTING) PER STANDARD PRODUCT LIST NO. WW-68	1" X 3/4"
C	BRASS NIPPLE - THREADED	3/4"
D	SAMPLING STATION PER STANDARD PRODUCT LIST NO. 68A	REQUIRED
E	USE SINGLE SERVICE METER BOX PER STANDARD PRODUCT LIST NO. WW-145A HYDE METER BOXES	REQUIRED
F	6" COMPACTED SAND	REQUIRED

* ALL FITTING CONNECTED TO POLYETHYLENE PIPE WILL REQUIRE A STAINLESS STEEL INSERT.

The City of San Marcos Engineering and Capital Improvements		CURRENT AS OF 1/1/2020	DISINFECTION WATER SAMPLE PORT	
RECORD COPY SIGNED BY _____ LAURIE MOYER, P.E.		1/1/2020 _____ ADOPTED	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	
			STANDARD NO. 511S-SP-SM 1 OF 2	

NOTES:

1. TOP OF BOXES SHALL BE 1" ABOVE GROUND OR FLUSH WITH PAVEMENT SURFACE.
2. PIPING AND TUBING SHALL BE EMBEDDED AS REQUIRED IN DETAIL 510S-S&L-SM.
3. CUT-OFF VALVE AND CONNECTION TO YARD PIPING TO BE SUBMITTED FOR APPROVAL.
4. SCH 40 PVC MALE ADAPTORS ARE NOT PERMITTED.
5. REPAIR TRENCH PER DETAIL 510S-S&L-SM.
6. THE SAMPLING STATION WILL BE CENTERED IN THE METER BOX.
7. TAP TO CITY WATER LINE WILL USE CITY DETAIL 520S-WMT-SM WITH 1" TAP TO MAIN.
8. TYPICAL CONNECTION IS OFF FIRE HYDRANT LEAD.
9. IF METER NOT IDENTIFIED FOR INSTALLATION BRASS PLUGS REQUIRED AT WATER METER COUPLING CONNECTIONS.

REFERENCES

DETAIL 510S-S&L-SM
DETAIL 520S-WMT-SM

The City of San Marcos Engineering and Capital Improvements	CURRENT AS OF 1/1/2020	DISINFECTION WATER SAMPLE PORT	
RECORD COPY SIGNED BY <hr/> LAURIE MOYER, P.E.	1/1/2020 <hr/> ADOPTED	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	STANDARD NO. 511S-SP-SM 2 OF 2