


**SECTION A-A**


**NOTES:**

1. STEEL POSTS WHICH SUPPORT THE SILT FENCE SHALL BE INSTALLED ON A SLIGHT ANGLE TOWARD THE ANTICIPATED RUNOFF SOURCE. POSTS SHALL MATCH THE TOP OF THE FENCE. POSTS MUST BE EMBEDDED A MINIMUM OF 1'.
2. THE TOE OF THE SILT FENCE SHALL BE TRENCHED IN WITH A SPADE OR MECHANICAL TRENCHER, SO THAT THE DOWNSLOPE FACE OF THE TRENCH IS FLAT AND PERPENDICULAR TO THE LINE OF FLOW.
3. THE TRENCH MUST BE A MINIMUM OF 6" DEEP AND 6" WIDE TO ALLOW FOR THE SILT FENCE FABRIC TO BE LAID IN THE GROUND AND BACKFILLED WITH COMPACTED MATERIAL.
4. SILT FENCE SHOULD BE SECURELY FASTENED TO EACH STEEL SUPPORT POST OR TO WOVEN WIRE, WHICH IS IN TURN ATTACHED TO THE STEEL FENCE POST.
5. INSPECTION SHALL BE MADE WEEKLY AND REPAIR OR REPLACEMENT SHALL BE MADE WITHIN 24 HOURS OF INSPECTION.
6. SILT FENCE SHALL BE REMOVED WHEN THE SITE IS PERMANENTLY STABILIZED SO AS NOT TO BLOCK OR IMPEDE STORM FLOW OR DRAINAGE.
7. ACCUMULATED SILT SHALL BE REMOVED WITHIN 24 HOURS WHEN IT REACHES A DEPTH OF 6" OR AS DIRECTED BY OWNER. THE SILT SHALL BE DISPOSED OF ON AN APPROVED SITE AND IN SUCH A MANNER THAT WILL NOT CONTRIBUTE TO ADDITIONAL SILTATION.
8. INSTALL J-HOOK SPACING PER ENGINEER'S DESIGN , BUT NOT TO EXCEED 200'.


<p><b>The City of San Marcos</b> Engineering and Capital Improvements</p>	<p>CURRENT AS OF 1/1/2021</p>	<p><b>SILT FENCE</b></p>	
<p>RECORD COPY SIGNED BY  LAURIE MOYER, P.E.</p>	<p>1/1/2020  ADOPTED</p>	<p>THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.</p>	<p>STANDARD NO. <b>642S-1-SM</b> 1 OF 2</p>

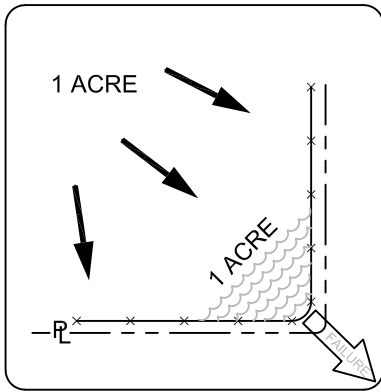

**INCORRECT** - DO NOT LAYOUT "PERIMETER CONTROL" SILT FENCE ALONG PROPERTY LINES. ALL SEDIMENT LADEN RUNOFF WILL CONCENTRATE AND OVERWHELM THE SYSTEM.

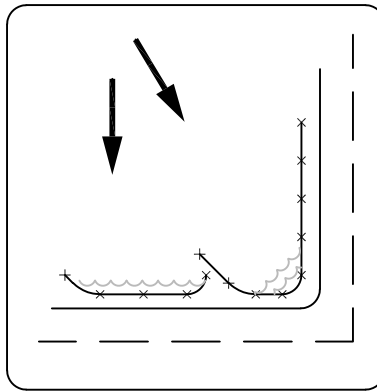

**CORRECT** - INSTALL J-HOOKS

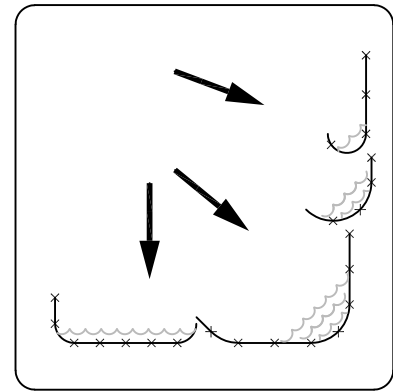

**CORRECT** - DISCREET SEGMENTS OF SILT FENCE INSTALLED WITH J-HOOKS OR 'SMILES' WILL BE MUCH MORE EFFECTIVE.


## SILT FENCE TURNBACK DETAIL

### SILT FENCE PLACEMENT FOR PERIMETER CONTROL

#### PLAN VIEW


DIRECTION OF  
SURFACE FLOW

I. SPACING REQUIREMENTS:



NOTE: SEE ENGINEER'S DESIGN PLANS FOR SPACING. MAX SPACING SHALL BE 200'

II. SIZING REQUIREMENTS:

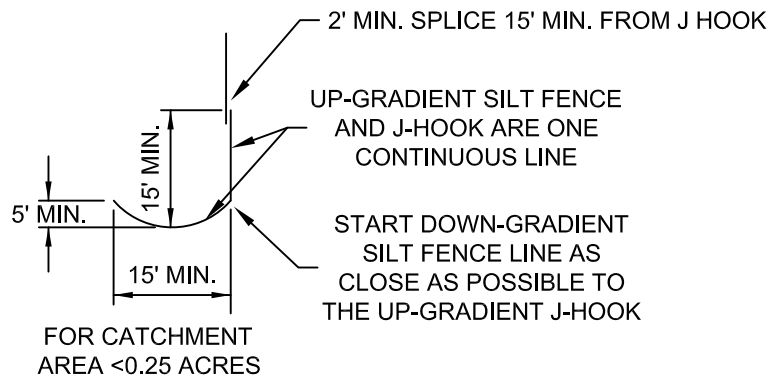

<b>The City of San Marcos</b> Engineering and Capital Improvements	CURRENT AS OF 1/1/2021	<b>SILT FENCE</b>	
RECORD COPY SIGNED BY <hr/> LAURIE MOYER, P.E.	1/1/2020 <hr/> ADOPTED	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	STANDARD NO. <b>642S-1-SM</b> 2 OF 2