


<b>The City of San Marcos</b> Engineering and Capital Improvements	CURRENT AS OF 1/1/2021	<b>STANDARD FIRE HYDRANT</b>	
RECORD COPY SIGNED BY LAURIE MOYER, P.E.	2/15/2019 ADOPTED	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.	STANDARD NO. <b>511-17-SM</b> 1 OF 2

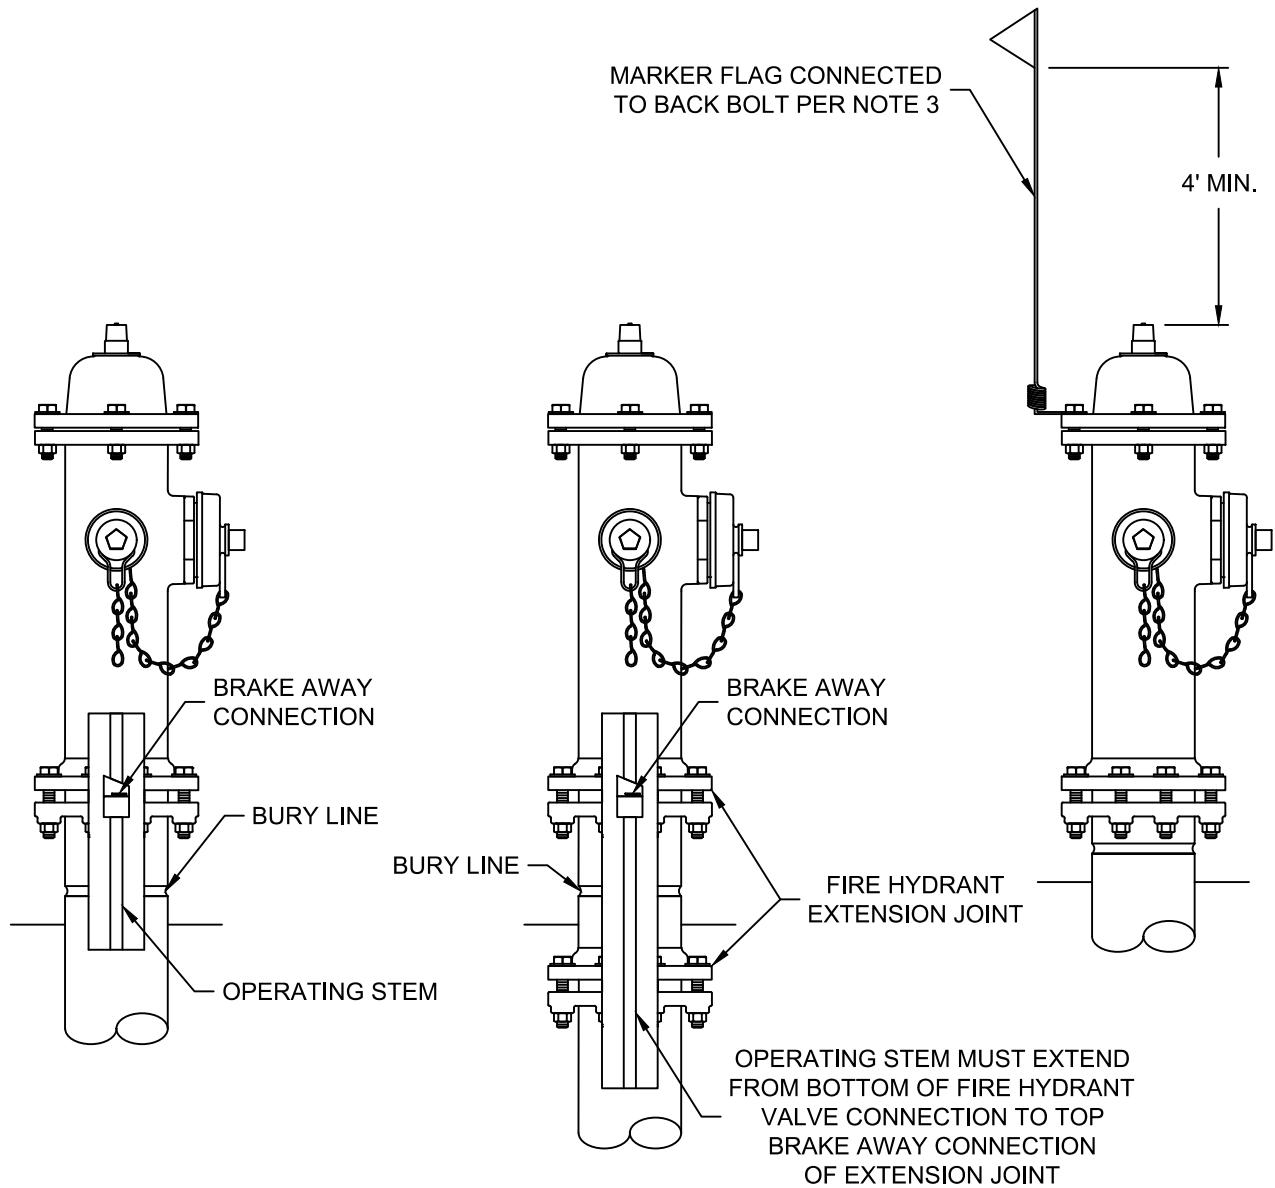

**NOTES:**

1. PUBLIC HYDRANTS SHALL BE FACTORY PAINTED WITH BRIGHT ALUMINUM BASED SILVER PAINT AND PRIVATE HYDRANTS SHALL BE PAINTED RED.
2. A BLUE REFLECTIVE PAVEMENT MARKER MUST BE PLACED WITH EVERY FIRE HYDRANT ADJACENT TO A ROADWAY 6"-10" OFF CENTER LINE OF ROAD ON FIRE HYDRANT SIDE.
3. FIRE HYDRANTS OUTSIDE ROW SHALL HAVE MARKING FLAGS IN RURAL AREAS.
4. FIRE HYDRANT MUST GO ON PAVEMENT SIDE OF FENCE, OR FENCE MUST BE REBUILT AROUND FIRE HYDRANT TO ALLOW ACCESS FROM PAVEMENT TO FIRE HYDRANT.
5. FIRE HYDRANT MAY ONLY MINIMALLY OBSTRUCT SIDEWALK AT EITHER EDGE
6. NO OBJECT THAT WILL OBSTRUCT MAINTENANCE OR USE OF THE FIRE HYDRANT WILL BE LOCATED WITH IN 5 FEET OF THE FIRE HYDRANT INCLUDING BUT NOT LIMITED TO (TREES, FENCES, TELEPHONE POLE, DUMPSTER, PERMANENT/NONPERMANENT STRUCTURES,...ETC.).
7. FIRE HYDRANT ASSEMBLY MUST BE PER CURRENT CITY OF SAN MARCOS STANDARD PRODUCT LIST.

**REFERENCES**

DETAIL 520S-WMT-SM

<b>The City of San Marcos</b> Engineering and Capital Improvements		CURRENT AS OF 1/1/2021	<b>STANDARD FIRE HYDRANT</b>	
RECORD COPY SIGNED BY <hr/> LAURIE MOYER, P.E.	2/15/2019 <hr/> ADOPTED	THE ARCHITECT/ENGINEER ASSUMES RESPONSIBILITY FOR APPROPRIATE USE OF THIS STANDARD.		STANDARD NO. <b>511-17-SM</b> 2 OF 2